

# FIRE RISK ASSESSMENT

PROPERTY ASSESSED:

New Delves Court  
Heanor  
Heanor

DE75 7EY



**UPRN:** FB275

**Inspection Date:** 15/08/2022

**Validation Date:** 20/09/2022


**Valid to:** 20/09/2023

**FRA completed by:** Pennington Choices


**FRA Completed For:** Futures



**FRA Risk Rating: Moderate**

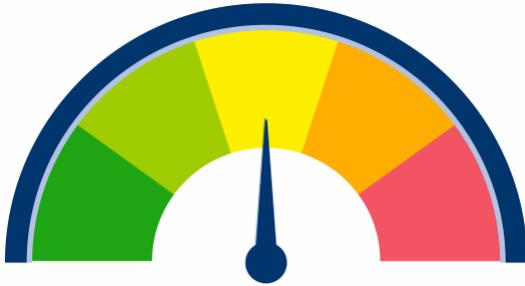

**FRA Action Count by Priority**

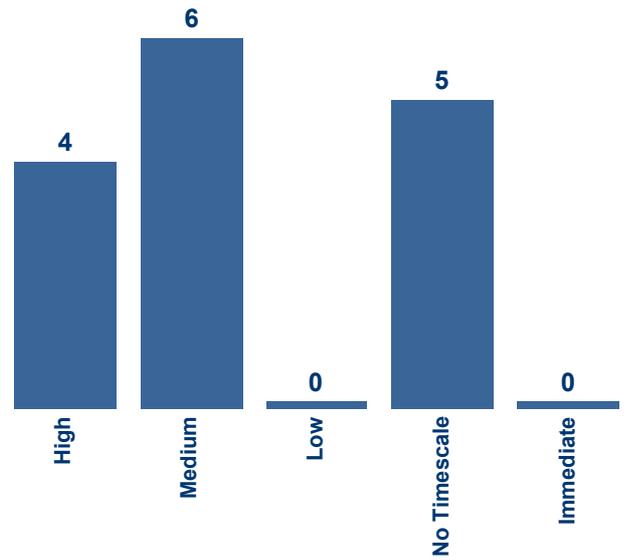

### FRA Action by Type

<b>Recommendations:</b>	<b>5</b>
<b>Actions:</b>	<b>10</b>

**Premises Risk Rating: Moderate**

**Reassessment Priority: High - 1 Year**

**Recommended evacuation strategy for this building is: Stay Put**

**On satisfactory completion of all remedial works the risk rating of this building may be reduced to: Tolerable**

## FRA - Summary

Responsible Person	CEO Futures
Property Designation	General needs
Management Extent	Partially Managed Building - Manager or Senior Staff not onsite regularly
No of Floors	3
No of Flats (if applicable)	6
Ground floor Area (m2)	160
Total Area of all floors (m2)	320

FRA Completed By:	Gary Broadhurst
FRA Type:	Type 1
QA Validation Date:	20/09/2022
QA Carried Out By:	Jack McLinden
Validator's Signature:	

High

6

Ref.	Category	Priority	Complete By
K4	Means Of Escape	High	20/Oct/2022
<b>Finding/Observation</b>		<b>Action/Recommendation</b>	
Both exit doors are in good working condition and the gate leading from the yard was unlocked however the main entrance door is provided with key lock		The exit doors must be provided with a suitable device that does not require a key to exit	
<p><b>Image: K41</b></p> 		<p><b>Image: K42</b></p> 	

Ref.	Category	Priority	Complete By
Q1	Measures To Limit Fire Spread And Development	High	20/Oct/2022
<b>Finding/Observation</b>		<b>Action/Recommendation</b>	
It was reported on site that a full compartmentation report has been provided which provides suitable evidence that an initial stay put policy is safe for residents however on inspection the meter room requires further fire stopping on the ceiling		Fire stopping is required by a third party accredited contractor to ensure the required fire separation between floors is achieved	
<p><b>Image: Q11</b></p> 			

Ref.	Category	Priority	Complete By
Q4	Measures To Limit Fire Spread And Development	High	20/Oct/2022
<b>Finding/Observation</b>		<b>Action/Recommendation</b>	
No access to the roof space is provided although the loft hatch was closed		Management to check compartmentation within the roof space over the common area	

# Findings & Actions Summary

Ref.	Category	Priority	Complete By
Q9	Measures To Limit Fire Spread And Development	High	20/Oct/2022
<b>Finding/Observation</b>		<b>Action/Recommendation</b>	
<p>The Juliette balconies do not appear to increase any risk of fire spread The front of the building is provided with cladding which requires further inspection and report to establish if it is safe to remain</p>		<p>The cladding should be further inspected by a qualified surveyor to establish if the materials used may assist in fire spread</p>	
<p><b>Image: Q92</b></p> 		<p><b>Image: Q91</b></p> 	

Medium

6

Ref.	Category	Priority	Complete By
H1	Hazards Introduced By Contractors	Medium	19/Dec/2022
<b>Finding/Observation</b>		<b>Action/Recommendation</b>	
Evidence was not available to confirm there is satisfactory control over works carried out in the building by contractors (e.g. hot work permits).		A documented procedure is recommended for ensuring all contractors are controlled on site and only operate within approved industry standards. This should include a permit to work and a hot work permit procedure where appropriate. All contractors should be advised of the emergency procedures and hazardous areas.	

Ref.	Category	Priority	Complete By
O1	Fire Safety Signs & Notices	Medium	19/Dec/2022
<b>Finding/Observation</b>		<b>Action/Recommendation</b>	
Signage was considered adequate and included, no smoking and fire action notices although the fire action notices are not clear and require revising. see B1		The fire action notices should be revised taking into account the provision of an alarm system in the common area and an evacuation strategy of initial stay put	
<p><b>Image: O11</b></p> 			

# Findings & Actions Summary

Ref.	Category	Priority	Complete By
P1	Means Of Giving Warning In Case Of Fire	Medium	19/Dec/2022
<b>Finding/Observation</b>		<b>Action/Recommendation</b>	
<p>The building is fitted with a domestic hard wired fire detection system in the common areas . In 'general needs' blocks designed to support a 'stay put' policy, it is unnecessary and undesirable for a fire alarm system to be provided. A communal fire detection and alarm system will inevitably lead to a proliferation of false alarms. This will impose a burden on fire and rescue services and lead to residents ignoring warnings of genuine fires.</p>		<p>Management to confirm the rationale of the presence of AFD within the common parts with a view to remove if not required or considered necessary.</p>	
<p><b>Image: P11</b></p> 			

Ref.	Category	Priority	Complete By
P7	Means Of Giving Warning In Case Of Fire	Medium	19/Dec/2022
<b>Finding/Observation</b>		<b>Action/Recommendation</b>	
<p>Access was provided inside the hallway of flat 6 which is fitted with linked smoke and heat detectors in the hall and kitchen</p>		<p>A category LD3 system should be considered the minimum in all circumstances". However, BS 5839-6:2019 states that "heat detectors should be installed in every kitchen. A smoke detector should be installed in the principal habitable room. Where more than one room might be used as the principal habitable room, a smoke detector should be installed in each of these rooms". It is recommended that each flat is checked to confirm that BS5839-6:2019 Grade D, LD2 detection is fitted.</p>	

# Findings & Actions Summary

Ref.	Category	Priority	Complete By
Q3	Measures To Limit Fire Spread And Development	Medium	19/Dec/2022
<b>Finding/Observation</b>		<b>Action/Recommendation</b>	
The cupboard was locked shut		Management to confirm that the fire separation between the cupboard and escape route are suitably separated including provision of a compliant fire door	
<p><b>Image: Q31</b></p> 			

Ref.	Category	Priority	Complete By
V1	Testing And Maintenance	Medium	19/Dec/2022
<b>Finding/Observation</b>		<b>Action/Recommendation</b>	
All fire safety provisions require testing in accordance with the relevant guides or standards		The green emergency exit release buttons must be tested and recorded in accordance with BS7273-4:2015	
<p><b>Image: V11</b></p> 			

## No Timescale

5

Ref.	Category	Priority	Complete By
F1	Lightning	No Timescale	
<b>Finding/Observation</b>		<b>Action/Recommendation</b>	
No lightning protection system was seen on site.		Recommend management undertake a risk assessment of the building to determine if lightning protection is required	

Ref.	Category	Priority	Complete By
Q6	Measures To Limit Fire Spread And Development	No Timescale	
<b>Finding/Observation</b>		<b>Action/Recommendation</b>	
No evidence is kept for inspection on site.		Management should confirm that where and if required fire dampers are provided as required	

Ref.	Category	Priority	Complete By
Q13	Measures To Limit Fire Spread And Development	No Timescale	
<b>Finding/Observation</b>		<b>Action/Recommendation</b>	
The gas meters are located next the car park		Consider provision of suitable protection such as bollards or steel fencing to protect the gas installations	
<p><b>Image: Q131</b></p> 			

# Findings & Actions Summary

Ref.	Category	Priority	Complete By
T6	Procedures And Arrangements	No Timescale	
<b>Finding/Observation</b>		<b>Action/Recommendation</b>	
Unable to confirm at the time of the assessment		Person Centered Fire Risk Assessments should be carried out on all tenants in general needs property, when required, and should be reviewed on an annual basis.	

Ref.	Category	Priority	Complete By
Y1	Engagement With Residents	No Timescale	
<b>Finding/Observation</b>		<b>Action/Recommendation</b>	
Unknown.		Ensure residents are informed of all relevant fire safety matters using different formats including letters, posters, social media etc	

Reassessment Priority	High - 1 Year
Responsible Person	CEO Futures
BAFE Cert	CHES077

## General Information

UPRN	FB275
Address	New Delves Court Heanor Heanor
Postcode	DE75 7EY
Fire Risk Assessor	Gary Broadhurst
Date of Inspection	15/08/2022
Checked by	Jack McLinden
Reassessment Date	15/08/2023

## General Information

Property Designation	General needs
Property Type	Purpose built block of flats
No of Floors	3
No of Flats (if applicable)	6
Ground floor area (m2)	160
Total area of all floors	320
Building Description	<p>4-9 New Delves court. The purpose built 3 storey block of flats was recently refurbished in accordance with current building regulations, is detached and stands well back with parking areas at the front of the property</p> <p>Advice was given on site to provide bollards or metal fence to protect the external gas metres as they are very close to the car park</p> <p>The building has 3 floors and 6 apartments (two on each floor level) which his traditionally constructed of brick with a pitched and tiled roof</p> <p>The apartments are located on all floors with the ground floor flats have secondary escape routes through patio doors</p> <p>The property has two exit doors, the main entrance door, which is is provided with overhead self-closing device and green button to exit. It is recommended that the key lock device inside is exchanged for a thumb turn device</p> <p>A secondary escape route into the yard via a final exit door is provided with push pad to exit, and the escape route leads to a gate that is secured internally with a sliding bolt</p> <p>All flats are provided with solid fire doors based on visual external inspection only which were all in good condition and certificated</p> <p>Several apartments above ground floor are provided with Juliette balconies</p>

The windows on the stairs can be opened to provide fresh air and ventilation  
Waste bins are stored outside the property in a dedicated area  
The escape routes including the stairs were clear of obstruction and in good condition  
The property is provided with a common area fire alarm system which appears compliant with BS 5839; part 6 and covers the escape routes which consists of hard-wired interlinked smoke detection  
The reason for providing the fire alarm in the common areas is unknown, as the building appears to support an initial stay put policy which is also confirmed on the fire action notices  
There is no provision of firefighting equipment, and signage included, general fire action notice at the main entrance as well no smoking signs  
The top floor is provided with a smoke ventilation system connected to a detector and manual reset button on the ground floor  
The front of the property has wooden cladding including above the main entrance  
No access was provided into the roof space to establish if separation is considered suitable and the service riser cupboard ceiling has exposed holes which require fire stopping  
It is recommended that a compartmentation report is carried out to establish if wooden cladding is safe, if the building supports an initial stay put policy, and if the fire detection in the common areas can be removed or must remain with simultaneous evacuation strategy in place  
Access was provided into flat 6 and the resident confirmed that a smoke detector is provided in the hallway and a detector in the kitchen  
Overall, the property appeared well kept, and clean and tidy

Building Construction	Traditional brick with pitched and tiled roof
Extent of common areas	Stairs and landings
Areas of the building to which access was not available	roof and apartments
If applicable state which flats were sample inspected	6

## 1. The Occupants

Ref.	Question	Policy Principles
10	Management Extent	
<b>Answer</b>		<b>Finding/Observation</b>
Partially Managed Building - Manager or Senior Staff not onsite regularly		
Ref.	Question	Policy Principles
11	Details of any onsite management (hours onsite etc.)	
<b>Answer</b>		<b>Finding/Observation</b>
Unknown.		
Ref.	Question	Policy Principles
12	Person managing fire safety in premises	
<b>Answer</b>		<b>Finding/Observation</b>
Shared responsibilities between Future and residents when occupied.		
Ref.	Question	Policy Principles
13	Person consulted during the fire risk assessment	
<b>Answer</b>		<b>Finding/Observation</b>
Ben Wood		
Ref.	Question	Policy Principles
14	Number of occupants (maximum estimated)	
<b>Answer</b>		<b>Finding/Observation</b>
30		
Ref.	Question	Policy Principles
15	Approximate maximum number of employees at any one time	
<b>Answer</b>		<b>Finding/Observation</b>
1		
Ref.	Question	Policy Principles
16	Number of members of the public (maximum estimated)	
<b>Answer</b>		<b>Finding/Observation</b>
8		

Ref.	Question	Policy Principles
17	Identify any people who are especially at risk: <ul style="list-style-type: none"><li>- sleeping occupants</li><li>- disabled occupants</li><li>- occupants in remote areas and lone workers</li><li>- young persons</li><li>- others</li></ul>	
Answer		Finding/Observation
This is a "general needs" block of flats that will have sleeping occupants. It is conceivable that there may be young persons, the elderly and children within the flats as part of families who reside there. There may also be occupants with varying degrees of physical/mental impairment. In addition, lone workers may be present within common parts of the premises.		

## 2. Fire Safety Legislation

Ref.	Question	Policy Principles
21	The following fire safety legislation applies to these premises	
<b>Answer</b>		<b>Finding/Observation</b>
Regulatory Reform (Fire Safety) Order 2005		

Ref.	Question	Policy Principles
22	The above legislation is enforced by	
<b>Answer</b>		<b>Finding/Observation</b>
Derbyshire Fire and Rescue Service		

Ref.	Question	Policy Principles
23	Other key fire safety legislation (other than Building Regs 2000)	
<b>Answer</b>		<b>Finding/Observation</b>
Housing Act 2004		

Ref.	Question	Policy Principles
24	The other legislation referred to above is enforced by	
<b>Answer</b>		<b>Finding/Observation</b>
Derby Council		

Ref.	Question	Policy Principles
25	Guidance used as applicable to premises and occupation	
<b>Answer</b>		<b>Finding/Observation</b>
Home Office (September 2021) Fire Safety in Purpose Built Blocks		

Ref.	Question	Policy Principles
26	Is there an alteration or enforcement notice in force?	
<b>Answer</b>		<b>Finding/Observation</b>
No		

Ref.	Question	Policy Principles
27	Fire loss experience (since last FRA)	
<b>Answer</b>		<b>Finding/Observation</b>
No		

## A. Electrical Ignition Sources

Ref.	Question	Policy Principles
A1	Is the fixed electrical installation periodically inspected and tested, (include dates if known)?	FHG complete Fixed wire testing in line with current regulations every 5 years and complete an annual visual inspection on all properties.
<b>Answer</b>		<b>Finding/Observation</b>
Yes		See principle.

Ref.	Question	Policy Principles
A2	Is PAT testing in common areas carried out?	PAT testing is complete at the time of the visual inspection as mentioned above. All items in the communal areas will be tested.
<b>Answer</b>		<b>Finding/Observation</b>
N/A		There are no portable electrical items in the common areas.

Ref.	Question	Policy Principles
A3	Is there a policy for personal electrical appliances (consider restrictions of communal supply points such as outlets and T pin outlets)?	All personal items are not to be left in communal areas. Mobility Scooter Policy
<b>Answer</b>		<b>Finding/Observation</b>
Yes		See principle.

Ref.	Question	Policy Principles
A4	Is the use of adapters and leads limited?	
<b>Answer</b>		<b>Finding/Observation</b>
N/A		

Ref.	Question	Policy Principles
A5	Are there any PV cells installed and do they have the appropriate isolation systems and signage to assist the fire and rescue service?	
<b>Answer</b>		<b>Finding/Observation</b>
No		

## B. Smoking Policies

Ref.	Question	Policy Principles
B1	Are there suitable arrangements to prevent fire as a result from smoking?	No smoking policy in all communal areas- signage displayed.
<b>Answer</b>		<b>Finding/Observation</b>
Yes		No smoking signs are displayed and no signs of smoking were seen inside the property at the time of the assessment.
<b>Images</b>		
<p>Image: B11</p> 		

Ref.	Question	Policy Principles
B2	Is the policy being adhered to and are "No smoking" signs provided in the common areas?	
<b>Answer</b>		<b>Finding/Observation</b>
Yes		See B1

## C. Arson

Ref.	Question	Policy Principles
C1	Are premises secure against arson by outsiders? (Please state how)	
<b>Answer</b>		<b>Finding/Observation</b>
Yes		The entrance door is provided with electronic access and was locked and secure at the time of the assessment The door is provided with Green push to release point and the rear door is provided with push pad
<b>Images</b>		
<div style="display: flex; justify-content: space-around; align-items: flex-start;"> <div style="text-align: center;"> <p><b>Image: C12</b></p>  </div> <div style="text-align: center;"> <p><b>Image: C13</b></p>  </div> <div style="text-align: center;"> <p><b>Image: C11</b></p>  </div> </div>		

Ref.	Question	Policy Principles
C2	Are bins secured or fire loading stored in a suitable location? (Please state bin type, location, if and how it is secured)	
<b>Answer</b>		<b>Finding/Observation</b>
Yes		Waste and recycling are stored safely outside near the front of the building. See main picture

## D. Portable Heaters And Heating Installations

Ref.	Question	Policy Principles
D1	If used, is the use of portable heaters regarded as safe?	
<b>Answer</b>		<b>Finding/Observation</b>
N/A		

Ref.	Question	Policy Principles
D2	Are fixed heating systems maintained annually?	All Safety inspections carried out annually by qualified persons.
<b>Answer</b>		<b>Finding/Observation</b>
N/A		No heating is provided in the common areas.

## E. Cooking

Ref.	Question	Policy Principles
E1	Are reasonable measures in place to prevent fires as a result of cooking, including replacing filter(where necessary)?	
<b>Answer</b>		<b>Finding/Observation</b>
N/A		No cooking facilities within the communal areas.

## F. Lightning

Ref.	Question	Policy Principles
F1	Does the building have a lightning protection system?	No lightning protection policy in place
<b>Answer</b>		<b>Finding/Observation</b>
No		No lightning protection system was seen on site.

## G. House-Keeping

Ref.	Question	Policy Principles
G1	Are combustible materials kept away from any sources of ignition, including gas and electrical intake cupboards?	
<b>Answer</b>		<b>Finding/Observation</b>
Yes		

Ref.	Question	Policy Principles
G2	Are the escape routes kept clear of items combustible materials or waste and free of any trip hazards?	
<b>Answer</b>		<b>Finding/Observation</b>
Yes		All common area escape routes including the stairs were clear of items

<b>Images</b>		
<p><b>Image: G21</b></p> 		

Ref.	Question	Policy Principles
G3	Are mobility scooters or electric vehicles stored in the means of escape? If yes has an assessment been undertaken in line with the NFCC "Mobility Scooter Guidance for Residential Buildings"?	
<b>Answer</b>		<b>Finding/Observation</b>
No		

## H. Hazards Introduced By Contractors

Ref.	Question	Policy Principles
H1	Is there satisfactory control over works carried out in the building by contractors (e.g. hot work permits)?	
<b>Answer</b>		<b>Finding/Observation</b>
Unknown		Evidence was not available to confirm there is satisfactory control over works carried out in the building by contractors (e.g. hot work permits).
<b>Action/Recommendation</b>		<b>Priority</b>
A documented procedure is recommended for ensuring all contractors are controlled on site and only operate within approved industry standards. This should include a permit to work and a hot work permit procedure where appropriate. All contractors should be advised of the emergency procedures and hazardous areas.		Medium
		<b>Due Date</b>
		19/Dec/2022

## I. Dangerous Substances

Ref.	Question	Policy Principles
I1	If dangerous substances are used, has a risk assessment been carried out as required by the Dangerous Substances and Explosives Atmospheres Regulations 2002 and are they stored correctly?	All contractors must submit RAMS for procurement processes, and these are reviewed annually by FHG. A specific risk assessment is to be completed for each job.
<b>Answer</b>		<b>Finding/Observation</b>
N/A		See principle.

## J. Other Significant Hazards

Ref.	Question	Policy Principles
J1	Are all issues deemed satisfactory? [1]	
<b>Answer</b>		<b>Finding/Observation</b>
Yes		
Ref.	Question	Policy Principles
J2	Are all issues deemed satisfactory?	
<b>Answer</b>		<b>Finding/Observation</b>
Yes		

## K. Means Of Escape

Ref.	Question	Policy Principles
K1	Is the escape route design deemed satisfactory? (Consider current design codes)	
<b>Answer</b>		<b>Finding/Observation</b>
Yes		

Ref.	Question	Policy Principles
K2	Is the fire-resisting construction (including any glazing) protecting escape routes and staircases of a suitable standard and maintained in sound condition?	
<b>Answer</b>		<b>Finding/Observation</b>
Yes		All fire doors were solid based on visual inspection and are certificated by a third party accredited contractor

Ref.	Question	Policy Principles
K3	Is there adequate provision of exits (including exit Widths) for the numbers who may be present?	
<b>Answer</b>		<b>Finding/Observation</b>
Yes		Ground floor flats have a secondary escape route through patio doors

### Images

Image: K31



Ref.	Question	Policy Principles	
K4	Are doors on escape routes easily opened? (and are sliding or revolving doors avoided?)		
<b>Answer</b>		<b>Finding/Observation</b>	
Yes		Both exit doors are in good working condition and the gate leading from the yard was unlocked however the main entrance door is provided with key lock	
<b>Action/Recommendation</b>		<b>Priority</b>	<b>Due Date</b>
The exit doors must be provided with a suitable device that does not require a key to exit		High	20/Oct/2022
<b>Images</b>			
<b>Image: K41</b>		<b>Image: K42</b>	
			

Ref.	Question	Policy Principles	
K5	Do final exits open in the direction of escape where necessary?		
<b>Answer</b>		<b>Finding/Observation</b>	
Yes			

Ref.	Question	Policy Principles	
K6	Are travels distances satisfactory? (consider single direction and more than one direction, property risk profile and occupancy characteristics)		
<b>Answer</b>		<b>Finding/Observation</b>	
Yes			

Ref.	Question	Policy Principles	
K7	Are there suitable precautions for all inner rooms?		
<b>Answer</b>		<b>Finding/Observation</b>	
N/A			

Ref.	Question	Policy Principles	
K8	Are escape routes separated where appropriate?		
<b>Answer</b>		<b>Finding/Observation</b>	
N/A			

Ref.	Question	Policy Principles
K9	Are corridors sub-divided where appropriate?	
<b>Answer</b>		<b>Finding/Observation</b>
N/A		

Ref.	Question	Policy Principles
K10	Do escape routes lead to a place of safety?	
<b>Answer</b>		<b>Finding/Observation</b>
Yes		All escape routes lead to stairs and the final exit door.

Ref.	Question	Policy Principles
K11	Are the stairs and/or lobbies provided with adequate ventilation? (If considered satisfactory, please state provision)	
<b>Answer</b>		<b>Finding/Observation</b>
Yes		The stairs are provided with opening windows and a smoke vent is provided at the head of the stairs with manual override button. See picture C1

**Images**

**Image: K112**




**Image: K111**



Ref.	Question	Policy Principles
K12	Is there any other issues that could affect the means of escape, for example plastic conduit/loose cables not secured by fire rated fastening?	
<b>Answer</b>		<b>Finding/Observation</b>
No		

## L. Flat Entrance Doors

Ref.	Question	Policy Principles
L1	Are the sample inspection flat entrance door or doors in good condition and appropriately fire rated?	
<b>Answer</b>		<b>Finding/Observation</b>
Yes		The flat entrance doors all appeared in good solid condition based on visual inspection and are certificated
<b>Images</b>		
<p>Image: L11</p> 		

## M. Common Area Fire Doors

Ref.	Question	Policy Principles
M1	Are all common area fire door and frames in good condition and appropriately fire rated?	
<b>Answer</b>		<b>Finding/Observation</b>
Yes		The only common area doors are the exit doors which are all in good useable condition. Also see Q3.

## N. Emergency Lighting

Ref.	Question	Policy Principles
N1	If emergency lighting is provided, is the coverage sufficient and in good repair? (Internal and external)	
<b>Answer</b>		<b>Finding/Observation</b>
Yes		The escape lights cover all the escape routes

**Images**

Image: N11



Ref.	Question	Policy Principles
N2	If EL not provided, is borrowed/artificial lighting sufficient for escape? (Internal and external)	
<b>Answer</b>		<b>Finding/Observation</b>
N/A		

## O. Fire Safety Signs & Notices

Ref.	Question	Policy Principles	
O1	Is there adequate provision of visible fire safety signs and notices? (Consider directional, exits, stairs, fire action notices, Fire door keep shut, fire equipment and 'do not use lift' signage)		
<b>Answer</b>		<b>Finding/Observation</b>	
Yes		Signage was considered adequate and included, no smoking and fire action notices although the fire action notices are not clear and require revising. see B1	
<b>Action/Recommendation</b>		<b>Priority</b>	<b>Due Date</b>
The fire action notices should be revised taking into account the provision of an alarm system in the common area and an evacuation strategy of initial stay put		Medium	19/Dec/2022
<b>Images</b>			
<p><b>Image: O11</b></p> 			

Ref.	Question	Policy Principles	
O2	Wayfinding Signage (buildings over 11 metres in height). Are there clear markings for flat and floor recognition provided?		
<b>Answer</b>		<b>Finding/Observation</b>	
N/A			

## P. Means Of Giving Warning In Case Of Fire

Ref.	Question	Policy Principles
P1	Is a reasonable fire detection and fire alarm system provided in the common areas, where necessary?	
<b>Answer</b>		<b>Finding/Observation</b>
Unknown		The building is fitted with a domestic hard wired fire detection system in the common areas . In 'general needs' blocks designed to support a 'stay put' policy, it is unnecessary and undesirable for a fire alarm system to be provided. A communal fire detection and alarm system will inevitably lead to a proliferation of false alarms. This will impose a burden on fire and rescue services and lead to residents ignoring warnings of genuine fires.
<b>Action/Recommendation</b>		<b>Priority</b>
Management to confirm the rationale of the presence of AFD within the common parts with a view to remove if not required or considered necessary.		Medium
		<b>Due Date</b>
		19/Dec/2022
<b>Images</b>		
<p>Image: P11</p> 		

Ref.	Question	Policy Principles
P2	If installed, is the common area AFD adequate for the occupancy and fire risk?	
<b>Answer</b>		<b>Finding/Observation</b>
Unknown		See P1

Ref.	Question	Policy Principles
P3	If not installed, are the premises deemed safe without a common area AFD system?	
<b>Answer</b>		<b>Finding/Observation</b>
N/A		

Ref.	Question	Policy Principles
P4	If there is a communal fire detection and fire alarm system, does it extend into the dwellings?	
<b>Answer</b>		<b>Finding/Observation</b>
No		

Ref.	Question	Policy Principles
P5	Where appropriate, has a fire alarm zone plan been provided?	
<b>Answer</b>		<b>Finding/Observation</b>
N/A		See P1.

Ref.	Question	Policy Principles
P6	Where appropriate, are there adequate arrangements for silencing and resetting an alarm condition?	
<b>Answer</b>		<b>Finding/Observation</b>
N/A		The system is self resetting

Ref.	Question	Policy Principles
P7	If applicable, is a separate domestic hard-wired smoke/heat alarm within the flats installed to a suitable standard?	
<b>Answer</b>		<b>Finding/Observation</b>
Unknown		Access was provided inside the hallway of flat 6 which is fitted with linked smoke and heat detectors in the hall and kitchen

Action/Recommendation	Priority	Due Date
A category LD3 system should be considered the minimum in all circumstances". However, BS 5839-6:2019 states that "heat detectors should be installed in every kitchen. A smoke detector should be installed in the principal habitable room. Where more than one room might be used as the principal habitable room, a smoke detector should be installed in each of these rooms". It is recommended that each flat is checked to confirm that BS5839-6:2019 Grade D, LD2 detection is fitted.	Medium	19/Dec/2022

Ref.	Question	Policy Principles
P8	If applicable (Sheltered scheme) is the smoke detection within the flats monitored by an alarm receiving centre/on site scheme manager via a telecare system?	
<b>Answer</b>		<b>Finding/Observation</b>
N/A		

## Q. Measures To Limit Fire Spread And Development

Ref.	Question	Policy Principles
Q1	Is there adequate levels of compartmentation between floors and between flats and the common escape routes?	
<b>Answer</b>		<b>Finding/Observation</b>
No		It was reported on site that a full compartmentation report has been provided which provides suitable evidence that an initial stay put policy is safe for residents however on inspection the meter room requires further fire stopping on the ceiling
<b>Action/Recommendation</b>		<b>Priority</b>
Fire stopping is required by a third party accredited contractor to ensure the required fire separation between floors is achieved		High
		<b>Due Date</b>
		20/Oct/2022
<b>Images</b>		
<p>Image: Q11</p> 		

Ref.	Question	Policy Principles
Q2	Are hidden voids appropriately enclosed and/or fire-stopped? (consider above suspended ceilings)	
<b>Answer</b>		<b>Finding/Observation</b>
N/A		

Ref.	Question	Policy Principles	
Q3	Is there adequately fire protected service risers and/or ducts in common areas, that will restrict the spread of fire and smoke?		
<b>Answer</b>		<b>Finding/Observation</b>	
Unknown		The cupboard was locked shut	
<b>Action/Recommendation</b>		<b>Priority</b>	<b>Due Date</b>
Management to confirm that the fire separation between the cupboard and escape route are suitably separated including provision of a compliant fire door		Medium	19/Dec/2022
<b>Images</b>			
<p><b>Image: Q31</b></p> 			

Ref.	Question	Policy Principles	
Q4	Is compartmentation maintained in the roof space?		
<b>Answer</b>		<b>Finding/Observation</b>	
Unknown		No access to the roof space is provided although the loft hatch was closed	
<b>Action/Recommendation</b>		<b>Priority</b>	<b>Due Date</b>
Management to check compartmentation within the roof space over the common area		High	20/Oct/2022

Ref.	Question	Policy Principles	
Q5	Are electrics, including embedded meters, enclosed in fire rated construction?		
<b>Answer</b>		<b>Finding/Observation</b>	
N/A			

Ref.	Question	Policy Principles	
Q6	As far as can reasonably be ascertained, are fire dampers provided as necessary to protect critical means of escape against passage of fire, smoke and products of combustion in the early stages of a fire?		
<b>Answer</b>		<b>Finding/Observation</b>	
Unknown		No evidence is kept for inspection on site.	

Ref.	Question	Policy Principles
Q7	Is there reasonable limitation of linings to escape routes that might promote fire spread?	
<b>Answer</b>		<b>Finding/Observation</b>
Yes		Walls and surface finishing's appeared to comply with class "0" materials.

Ref.	Question	Policy Principles
Q8	Are soft furnishings in common areas appropriate to limit fire spread/growth?	
<b>Answer</b>		<b>Finding/Observation</b>
N/A		

Ref.	Question	Policy Principles
Q9	Does the premises have any external balconies, cladding or materials which may promote external fire spread?	
<b>Answer</b>		<b>Finding/Observation</b>
Yes		The Juliette balconies do not appear to increase any risk of fire spread The front of the building is provided with cladding which requires further inspection and report to establish if it is safe to remain

Action/Recommendation	Priority	Due Date
The cladding should be further inspected by a qualified surveyor to establish if the materials used may assist in fire spread	High	20/Oct/2022

Images
<div style="display: flex; justify-content: space-around;"> <div style="text-align: center;"> <p><b>Image: Q92</b></p>  </div> <div style="text-align: center;"> <p><b>Image: Q91</b></p>  </div> </div>

Ref.	Question	Policy Principles
Q10	Has a note been prepared of the external walls of the building and details of construction materials used? Does the note include and identify the level of risk that the design and materials used?	
<b>Answer</b>		<b>Finding/Observation</b>
Unknown		See Q9

Ref.	Question	Policy Principles
Q11	Does the External wall note include any mitigating circumstances that may have been taken to reduce the risk?	
<b>Answer</b>		<b>Finding/Observation</b>
Unknown		See Q9

Ref.	Question	Policy Principles
Q12	Has the responsible person reviewed the external wall note on a regular basis and revised it if there have been any significant changes in the external walls.	
<b>Answer</b>		<b>Finding/Observation</b>
Unknown		See Q9

Ref.	Question	Policy Principles
Q13	Are all other fire spread/compartmentation issues satisfactory?	
<b>Answer</b>		<b>Finding/Observation</b>
No		The gas meters are located next the car park

Images		
<p><b>Image: Q131</b></p> 		

## R. Fire Extinguishing Appliances

Ref.	Question	Policy Principles
R1	if required, is there reasonable provision of accessible portable fire extinguishers?	
<b>Answer</b>		<b>Finding/Observation</b>
N/A		Typically fire extinguishers are not provided within this type of property as residents are unlikely to have been appropriately trained.

## S. Relevant Automatic Fire Extinguishing Systems

Ref.	Question	Policy Principles
S1	Are there any automatic fire suppressant systems on site?	
<b>Answer</b>		<b>Finding/Observation</b>
No		

Ref.	Question	Policy Principles
S2	Are there any fixed fire fighting mains within the premises?	
<b>Answer</b>		<b>Finding/Observation</b>
No		

Ref.	Question	Policy Principles
S3	If any other relevant systems / equipment is installed, state type of system and comment as necessary	
<b>Answer</b>		<b>Finding/Observation</b>
No		

## T. Procedures And Arrangements

Ref.	Question	Policy Principles
T1	Recommended evacuation strategy for this building is	
<b>Answer</b>		<b>Finding/Observation</b>
	Stay Put	As per P1.

Ref.	Question	Policy Principles
T2	Has a competent person(s) been appointed to assist in undertaking the preventative and protective measures including in house checks?	
<b>Answer</b>		<b>Finding/Observation</b>
	Yes	The visiting officer was aware of all fire safety provisions and requirements for the site, and carries out regular inspections.

Ref.	Question	Policy Principles
T3	Are there appropriate documented fire safety arrangements and procedures in place in the event of fire?	
<b>Answer</b>		<b>Finding/Observation</b>
	No	See O1

Ref.	Question	Policy Principles
T4	Are there suitable arrangements for liaison and calling the Fire Service?	
<b>Answer</b>		<b>Finding/Observation</b>
	Yes	Staff, contractors, residents or visitors when the building is occupied will call 999.

Ref.	Question	Policy Principles
T5	Are there suitable fire assembly points away from any risk?	
<b>Answer</b>		<b>Finding/Observation</b>
	Yes	The fire assembly point is outside and is clear of the building.

Ref.	Question	Policy Principles
T6	Are there adequate procedures in place for the evacuation of disabled people who are likely to be present?	
<b>Answer</b>		<b>Finding/Observation</b>
	Unknown	Unable to confirm at the time of the assessment

Ref.	Question	Policy Principles
T7	Are staff nominated and trained on the use of fire extinguishing appliances?	
<b>Answer</b>		<b>Finding/Observation</b>
	N/A	No staff on site.

Ref.	Question	Policy Principles
T8	Are staff nominated and trained to assist in evacuation (Where applicable e.g. Offices, supported schemes)?	
<b>Answer</b>		<b>Finding/Observation</b>
N/A		No staff on site.

## U. Training

Ref.	Question	Policy Principles
U1	Do staff receive adequate induction and annual refresher fire safety training? (To include fire risks in the premises, fire safety measures in the building, action in the event of fire and on hearing alarm, location and use of fire extinguishers, calling the fire service)	All touchdown points (small offices) staff receive Inductions and annual refreshers on fire safety fire safety. But at all the schemes no permanent staff are present.
<b>Answer</b>		<b>Finding/Observation</b>
N/A		No staff on site.

Ref.	Question	Policy Principles
U2	Are employees nominated to assist in the event of fire given additional training?	
<b>Answer</b>		<b>Finding/Observation</b>
N/A		No staff on site.

## V. Testing And Maintenance

Ref.	Question	Policy Principles	
V1	Are all fire safety provisions for the building (AFD, Emergency Lighting, sprinklers etc.) routinely tested and maintained?	Alarms- FHG Greenscapes, MITIE E/L- FHG Greenscapes, MITIE, Assets Surveyor Extinguishers- MITIE Fire Doors- FHG Greenscapes, Assets Surveyor Final Exits/ Escape Routes- Greenscapes/ Neighbourhoods	
<b>Answer</b>		<b>Finding/Observation</b>	
Yes		All fire safety provisions require testing in accordance with the relevant guides or standards	
<b>Action/Recommendation</b>		<b>Priority</b>	<b>Due Date</b>
The green emergency exit release buttons must be tested and recorded in accordance with BS7273-4:2015		Medium	19/Dec/2022

### Images

Image: V11



## W. Records

Ref.	Question	Policy Principles
W1	Is all routine testing and staff training including fire drills suitably recorded and available for inspection?	
<b>Answer</b>		<b>Finding/Observation</b>
Yes		Records are available to view online.

## X. Premises Information Box

Ref.	Question	Policy Principles
X1	Is a Premises Information Box located at the premises accessible to the Fire and Rescue Service, secure from unauthorised access and kept up to date?	Log book is kept on SharePoint with proposed specific QR code access.
<b>Answer</b>		<b>Finding/Observation</b>
N/A		Not required.

## Y. Engagement With Residents

Ref.	Question	Policy Principles
Y1	Has all Fire Safety information & procedures been disseminated to the residents?	
<b>Answer</b>		<b>Finding/Observation</b>
Unknown		Unknown.

## Z. Any Other Information

Ref.	Question	Policy Principles
Z1	Are all issues deemed satisfactory? [1]	
<b>Answer</b>		<b>Finding/Observation</b>
Yes		
Ref.	Question	Policy Principles
Z2	Are all issues deemed satisfactory?	
<b>Answer</b>		<b>Finding/Observation</b>
Yes		

## ZAAR. Assessment Risk Ratings

Ref.	Question	Policy Principles
ZAAR1	<p>Likelihood of Fire</p> <p>Low: Unusually low likelihood of fire as a result of negligible potential sources of ignition.</p> <p>Medium: Normal fire hazards (e.g. potential ignition sources) for this type of occupancy, with fire hazards generally subject to appropriate controls (other than minor shortcomings).</p> <p>High: Lack of adequate controls applied to one or more significant fire hazards, such as to result in significant increase in likelihood of fire</p>	
<b>Answer</b>		<b>Finding/Observation</b>
Medium		

Ref.	Question	Policy Principles
ZAAR2	<p>Potential Consequences of Fire</p> <p>Slight harm: Outbreak of fire unlikely to result in serious injury or death of any occupant.</p> <p>Moderate harmful: Outbreak of fire could foreseeably result in injury (including serious injury) of one or more occupants, but it is unlikely to involve multiple fatalities.</p> <p>Extreme harm: Significant potential for serious injury or death of one or more occupants likely to involve multiple fatalities</p>	
<b>Answer</b>		<b>Finding/Observation</b>
Moderate Harm		

Ref.	Question	Policy Principles
ZAAR3	<p>Premises Risk Rating</p> <p>Trivial: No action is required and no detailed records need be kept</p> <p>Tolerable: No major additional controls required. However, there might be a need for improvements that involve minor or limited cost.</p> <p>Moderate: It is essential that efforts are made to reduce the risk. Risk reduction measures should be implemented within a defined time period. Where moderate risk is associated with consequences that constitute extreme harm, further assessment might be required to establish more precisely the likelihood of harm as a basis for determining the priority for improved control measures.</p> <p>Substantial: Considerable resources might have to be allocated to reduce the risk. If the building is unoccupied, it should not be occupied until the risk has been reduced. If the building is occupied, urgent action should be taken.</p> <p>Intolerable: Building (or relevant area) should not be occupied until the risk is reduced</p>	
<b>Answer</b>		<b>Finding/Observation</b>
Moderate		

Ref.	Question	Policy Principles
ZAAR4	On satisfactory completion of all remedial works the risk rating of this building may be reduced to:	
<b>Answer</b>		<b>Finding/Observation</b>
Tolerable		

## Risk Assessment - Type 3



### flat 6

#### 1. Inspection Details

11	Has a Type 3 dwelling survey been performed?	Yes
12	Which flat number was accessed?	6
13	Is there appropriate detection in place?	Unknown

#### 2. What Detection Is In Place?

21	Mains Smoke Detector in Hall	Yes
22	Main Smoke Detector in Lounge	Unknown
23	Mains Heat Detector in Kitchen	Yes
24	Main Detection in Bedroom(s)	Unknown
25	Battery Smoke in hall	No
26	Link Heat detector in hall	No
27	Other	Unknown

#### 3. General

31	If on the ground or 1st floors, is there secondary means of escape from each habitable room? Door or window of at least 0.33m <sup>2</sup> with no single dimension smaller than 450mm.	Unknown
32	Does the layout of the flat meet the relevant Building Regulations (Travel distance, protected entrance hall, alternative escape etc.?)	Unknown
33	Are there any extraction fans that are not vented directly to an external wall?	Unknown
34	Are there any missing internal doors?	No
35	Is the fixed electrical test in date?	Unknown
36	Are there any signs of hoarding?	No
37	Is the cooker in a safe position?	Unknown
38	Assessor's Miscellaneous Comments or observations - please consider compartmentation within the flat or any tenant alterations?	No access was granted inside the flat and all information was passed on from the resident

The following simple risk level estimator is based on a more general health and safety risk level estimator of the type contained in BS 8800:

Likelihood of fire	Potential consequences of fire		
	Slight Harm	Moderate Harm	Extreme Harm
Low	Trivial	Tolerable	Moderate
Medium	Tolerable	Moderate	Substantial
High	Moderate	Substantial	Intolerable

Taking into account the fire prevention measures observed at the time of this risk assessment, it is considered that the hazard from fire (likelihood of fire) at these premises is:	<b>Medium</b>
--	---------------

In this context, a definition of the above terms is as follows:

**Low:** Unusually low likelihood of fire as a result of negligible potential sources of ignition.

**Medium:** Normal fire hazards (e.g. potential ignition sources) for this type of occupancy, with fire hazards generally subject to appropriate controls (other than minor shortcomings).

**High:** Lack of adequate controls applied to one or more significant fire hazards, such as to result in significant increase in likelihood of fire.

Taking into account the nature of the building and occupants, as well as the fire protection and procedural arrangements observed at the time of this fire risk assessment, it is considered that the consequences for life safety in the event of fire would be:	<b>Moderate Harm</b>
---	----------------------

In this context, a definition of the above terms is as follows:

**Slight harm:** Outbreak of fire unlikely to result in serious injury or death of any occupant.

**Moderate harmful:** Outbreak of fire could foreseeably result in injury (including serious injury) of one or more occupants, but it is unlikely to involve multiple fatalities.

**Extreme harm:** Significant potential for serious injury or death of one or more occupants likely to involve multiple fatalities.

Accordingly, it is considered that the risk to life from fire at these premises is:	<b>Moderate</b>
---	-----------------

A suitable risk-based control plan should involve effort and urgency that is proportional to risk. The following risk-based control plan is based on one advocated by BS 8800 for general health and safety risks:

Risk Level	Action and time table
Trivial	No action is required and no detailed records need be kept.
Tolerable	No major additional controls required. However, there might be a need for improvements that involve minor or limited cost.
Moderate	It is essential that efforts are made to reduce the risk. Risk reduction measures should be implemented within a defined time period. Where moderate risk is associated with consequences that constitute extreme harm, further assessment might be required to establish more precisely the likelihood of harm as a basis for determining the priority for improved control measures.
Substantial	Considerable resources might have to be allocated to reduce the risk. If the building is unoccupied, it should not be occupied until the risk has been reduced. If the building is occupied, urgent action should be taken.
Intolerable	Building (or relevant area) should not be occupied until the risk is reduced.

*(Note that, although the purpose of this section is to place the risk in context, the above approach to fire risk assessment is subjective and for guidance only. All hazards and deficiencies identified in this report should be addressed by implementing all recommendations contained in the following action plan. The fire risk assessment should be reviewed regularly.)*



## Life Safety Fire Risk Assessment Certificate of Conformity

This certificate is issued by the organization named in Part 1 of the schedule in respect of fire risk assessment provided for the person(s) or organization named in Part 2 of the schedule at the premises and / or part of the premises identified in Part 3 of the schedule.

### Schedule:

Part 1a	Name & Address of Certified Organisation:
	Pennington Choices, Broofield House, Grimsditch Lane, WA4 4EA
Part 1b	BAFE registration number of issuing Certified Organization:
	102119
Part 1c	SSAIB 3rd Party Certificate Number:
	CHES077
Part 2	Name of Client:
	CEO Futures
Part 3a	Address of premises for which the fire risk assessment was carried out:
	New Delves Court Heanor Heanor DE75 7EY
Part 3b	Part or parts of the premises to which the fire risk assessment applies:
	Common Parts only (not dwellings, where applicable)
Part 4	Brief description of the scope and purpose of the fire risk assessment:
	Life Safety (as per agreed Specification)
Part 5	Effective date of the fire risk assessment:
	15/08/2022
Part 6	Recommended date for reassessment of the premises:
	15/08/2023
Part 7	Unique reference number of this certificate:
	109719

Signed for and on behalf of the issuing Certificated Organization:

James Hutton

Dated: 9/20/2022

## Appendix 1. Action Details

Ref.	Category	Priority	Comments	Recommendation	Quantity	To Be Completed By	Photo Ref.
F1	LIGHTNING	No Timescale	No lightning protection system was seen on site.	Recommend management undertake a risk assessment of the building to determine if lightning protection is required			
H1	HAZARDS INTRODUCED BY CONTRACTORS	Medium	Evidence was not available to confirm there is satisfactory control over works carried out in the building by contractors (e.g. hot work permits).	A documented procedure is recommended for ensuring all contractors are controlled on site and only operate within approved industry standards. This should include a permit to work and a hot work permit procedure where appropriate. All contractors should be advised of the emergency procedures and hazardous areas.		19/12/2022	
K4	MEANS OF ESCAPE	High	Both exit doors are in good working condition and the gate leading from the yard was unlocked however the main entrance door is provided with key lock	The exit doors must be provided with a suitable device that does not require a key to exit		20/10/2022	K41, K42
O1	FIRE SAFETY SIGNS & NOTICES	Medium	Signage was considered adequate and included, no smoking and fire action notices although the fire action notices are not clear and require revising. see B1	The fire action notices should be revised taking into account the provision of an alarm system in the common area and an evacuation strategy of initial stay put		19/12/2022	O11
P1	MEANS OF GIVING WARNING IN CASE OF FIRE	Medium	The building is fitted with a domestic hard wired fire detection system in the common areas . In 'general needs' blocks designed to support a 'stay put' policy, it is unnecessary and undesirable for a fire alarm system to be provided. A communal fire detection and alarm system will inevitably lead to a proliferation of false alarms. This will impose a burden on fire and rescue services and lead to residents ignoring warnings of genuine fires.	Management to confirm the rationale of the presence of AFD within the common parts with a view to remove if not required or considered necessary.		19/12/2022	P11

Ref.	Category	Priority	Comments	Recommendation	Quantity	To Be Completed By	Photo Ref.
P7	MEANS OF GIVING WARNING IN CASE OF FIRE	Medium	Access was provided inside the hallway of flat 6 which is fitted with linked smoke and heat detectors in the hall and kitchen	A category LD3 system should be considered the minimum in all circumstances". However, BS 5839-6:2019 states that "heat detectors should be installed in every kitchen. A smoke detector should be installed in the principal habitable room. Where more than one room might be used as the principal habitable room, a smoke detector should be installed in each of these rooms". It is recommended that each flat is checked to confirm that BS5839-6:2019 Grade D, LD2 detection is fitted.		19/12/2022	
Q1	MEASURES TO LIMIT FIRE SPREAD AND DEVELOPMENT	High	It was reported on site that a full compartmentation report has been provided which provides suitable evidence that an initial stay put policy is safe for residents however on inspection the meter room requires further fire stopping on the ceiling	Fire stopping is required by a third party accredited contractor to ensure the required fire separation between floors is achieved		20/10/2022	Q11
Q3	MEASURES TO LIMIT FIRE SPREAD AND DEVELOPMENT	Medium	The cupboard was locked shut	Management to confirm that the fire separation between the cupboard and escape route are suitably separated including provision of a compliant fire door		19/12/2022	Q31
Q4	MEASURES TO LIMIT FIRE SPREAD AND DEVELOPMENT	High	No access to the roof space is provided although the loft hatch was closed	Management to check compartmentation within the roof space over the common area		20/10/2022	
Q6	MEASURES TO LIMIT FIRE SPREAD AND DEVELOPMENT	No Timescale	No evidence is kept for inspection on site.	Management should confirm that where and if required fire dampers are provided as required			
Q9	MEASURES TO LIMIT FIRE SPREAD AND DEVELOPMENT	High	The Juliette balconies do not appear to increase any risk of fire spread The front of the building is provided with cladding which requires further inspection and report to establish if it is safe to remain	The cladding should be further inspected by a qualified surveyor to establish if the materials used may assist in fire spread		20/10/2022	Q92, Q91
Q13	MEASURES TO LIMIT FIRE SPREAD AND DEVELOPMENT	No Timescale	The gas meters are located next the car park	Consider provision of suitable protection such as bollards or steel fencing to protect the gas installations			Q131
T6	PROCEDURES AND ARRANGEMENTS	No Timescale	Unable to confirm at the time of the assessment	Person Centered Fire Risk Assessments should be carried out on all tenants in general needs property, when required, and should be reviewed on an annual basis.			

Ref.	Category	Priority	Comments	Recommendation	Quantity	To Be Completed By	Photo Ref.
V1	TESTING AND MAINTENANCE	Medium	All fire safety provisions require testing in accordance with the relevant guides or standards	The green emergency exit release buttons must be tested and recorded in accordance with BS7273-4:2015		19/12/2022	V11
Y1	ENGAGEMENT WITH RESIDENTS	No Timescale	Unknown.	Ensure residents are informed of all relevant fire safety matters using different formats including letters, posters, social media etc			